


Configuring Azbil savic-net FX (BAS-BMS) for AlertDispatcher

Note: Before configuring savic-net FX, please install AlertDispatcher as per "[AlertDispatcher Quick Installation Guide.pdf](#)".


1. Login to savic-net FX as admin user, click on System → Mail Server Setup

Note:


1. You will also need to ensure that you are able to successfully PING the controller from AlertDispatcher PC.
2. If firewall is enabled, TCP Port 25 must be opened on the AlertDispatcher PC.

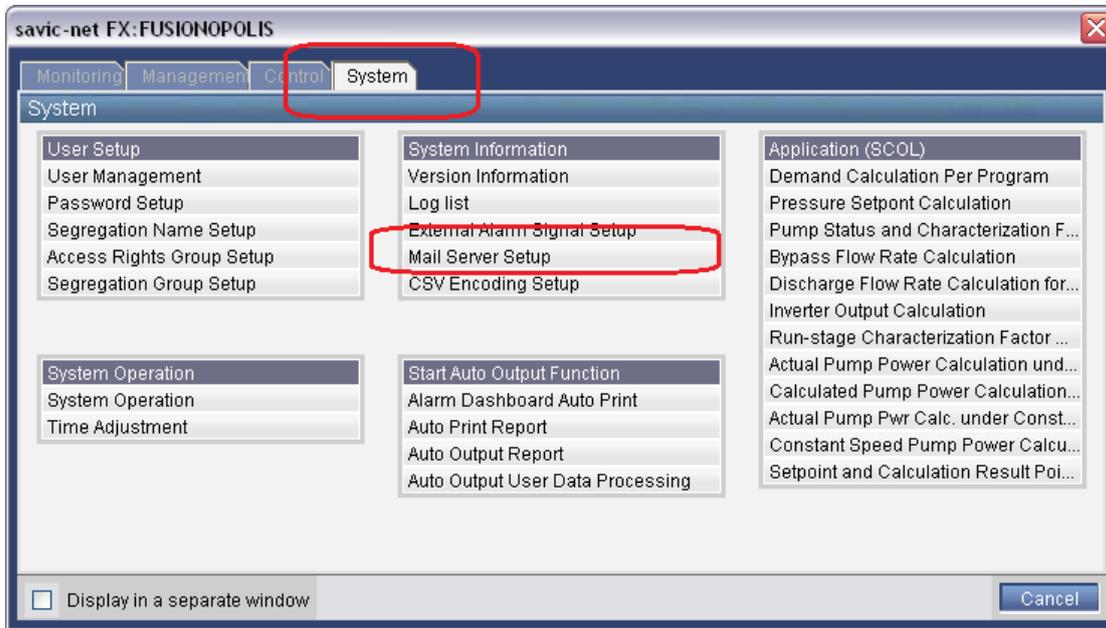


Next, enter the IP address or hostname of the machine on which AlertDispatcher is installed.

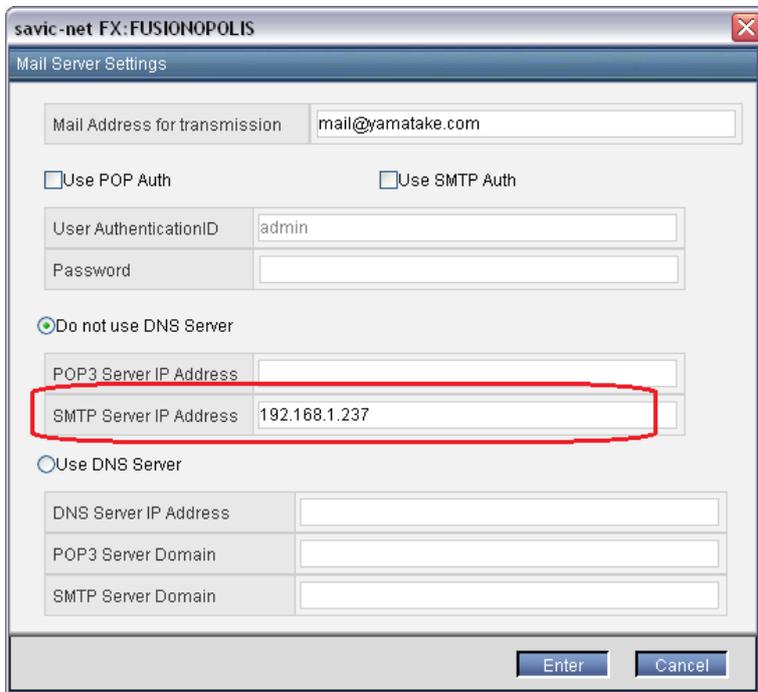

2. Go to System → User Setup

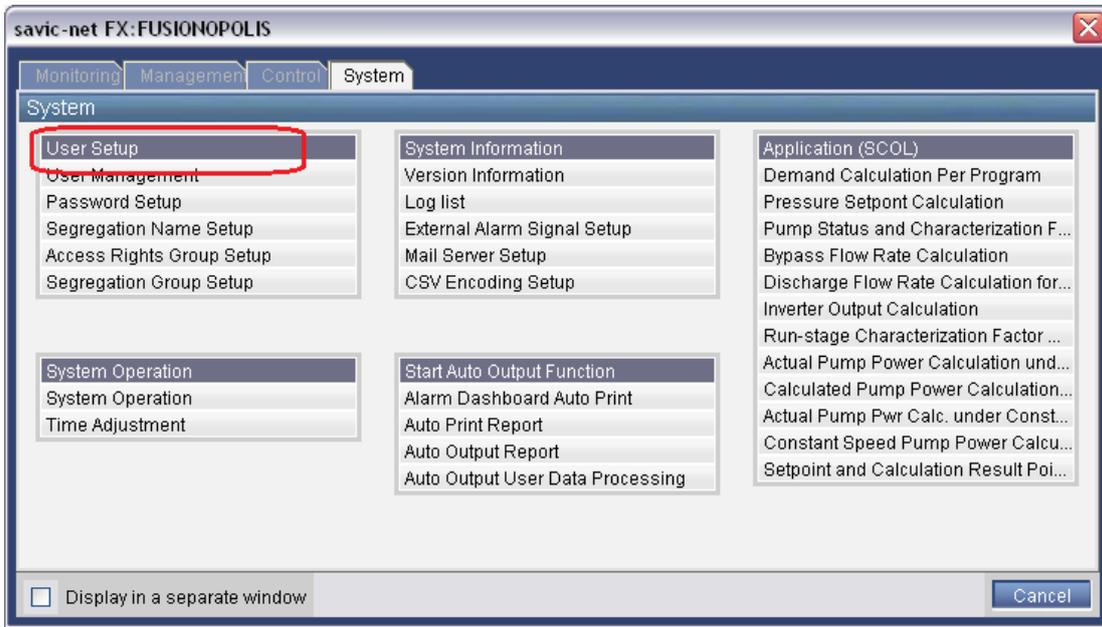

Next select drop down menu for “Display Screen”, select “Alarm E-mail Notification Settings Dialog”.

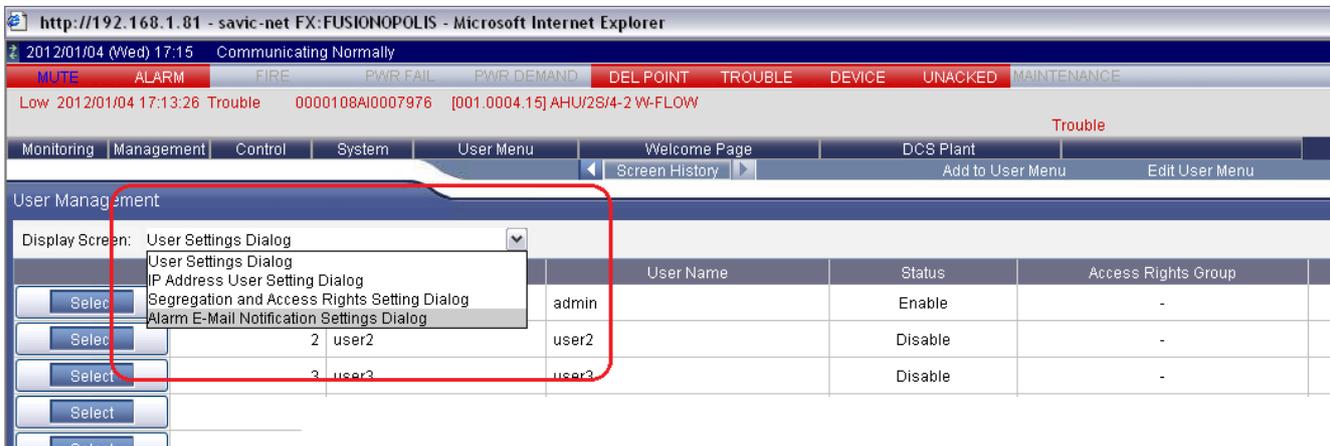

Click on "Select" button in order to amend the Alarm E-mail Notification Settings for a particular user.

Display Screen: User Settings Dialog

			User Name	St
Select			admin	En
Select	2	user2	user2	Dis
Select	3	user3	user3	Dis
Select				

Toggle "Yes" under Alarm E-mail Notification to enable notification to that user. You will also need to select the Alarm Levels for which notification is triggered, and also assign the Alarm level to individual points.

In the example below, the E-mail is management@yahoo.com, for this you will need to setup the 'management' group in AlertDispatcher phonebook. If you want to bypass the AlertDispatcher phone book, you can use the mobile phone number within the E-mail, e.g. +6591234567@yahoo.com. Note that the domain name does not matter.

The screenshot shows the 'Set Alarm E-Mail Notification' window. At the top, it displays 'User ID: admin' and 'User Name: admin'. Below this, there are two sections highlighted with red boxes:

- Alarm E-Mail Notification:** A section with a 'Yes' radio button selected and a 'No' radio button. Below it, the 'Notification Status' is 'E-Mail Notification in process'.
- Notification Message:** A section with 'Alarm Type' set to 'Alarm/Recovered' (radio button selected) and 'Alarm Level' set to 'Urgent' (checkbox checked).

The 'Mail To' section contains a table with the following data:

	E-Mail Address	Notification Format	Guidance URL	Test
<input type="button" value="Set"/>	Management@yahoo.com	PC Mailer 1	Yes	<input type="button" value="Test"/>
<input type="button" value="Set"/>				<input type="button" value="Test"/>
<input type="button" value="Set"/>				<input type="button" value="Test"/>
<input type="button" value="Set"/>				<input type="button" value="Test"/>

At the bottom of the window, there are 'Enter' and 'Cancel' buttons.

Click on the test button to test send Alarm. This step is very crucial as the alerts won't work unless Test works in the first place. If an alarm is successfully received from the controller, it will be displayed under AlertDispatcher "Messages" tab. If you do not see this alarm message, please check the firewall - refer to "Port Conflicts, Firewall and AntiVirus Software Setup" under "AlertDispatcher Quick Installation Guide.pdf".

Note: AlertDispatcher Installer can be downloaded from [this link](#).